

Selecting Ventilation Air Filters to Reduce PM_{2.5} Of Outdoor Origin

BY BRENT STEPHENS, PH.D., ASSOCIATE MEMBER ASHRAE; TERRY BRENNAN, MEMBER ASHRAE; LEW HARRIMAN, FELLOW ASHRAE

ASHRAE Standards 62.1 and 62.2 specify minimum ventilation rates, minimum requirements for HVAC particle filtration efficiency, and other measures intended to provide acceptable indoor air quality (IAQ) in commercial and residential buildings. Although the minimum requirements are designed to address both indoor and outdoor sources of airborne pollutants, highly polluted outdoor air presents a challenge to providing clean outdoor air to meet ventilation needs in many parts of the world.

High pollutant concentrations in outdoor air are consistently linked to an array of adverse acute and chronic health effects.¹ In particular, exposure to ambient fine particulate matter (i.e., PM_{2.5}, the mass concentration of particles smaller than 2.5 μm in aerodynamic diameter) accounts for much of the adverse health effects associated with outdoor air pollution.² Ambient PM_{2.5} is the seventh-most important risk factor contributing to global mortality, accounting for over 3 million premature deaths worldwide (predominantly in Asia).^{3,4} Although this knowledge derives from epidemiological associations between outdoor PM_{2.5} concentrations and adverse health outcomes,⁵ the majority of human exposure to outdoor PM_{2.5} often occurs indoors where people spend most of their time.⁶

The design and operation of HVAC systems can greatly impact the fraction of outdoor PM_{2.5} that penetrates and persists inside buildings.⁷⁻¹⁰ Indoor activities also affect particle concentrations in the breathing zone, but clearly, using filters to remove particulate matter from outdoor air before it enters the building can be highly beneficial. Particle filtration in mixed airstreams (which includes outdoor air) has long been standard practice in commercial buildings. However, only recently has this need become clear for residential buildings as well.

For example, ASHRAE Standard 62.2-2016 now calls for dedicated continuous or intermittent outdoor air delivery by mechanical means, although the outdoor air does not have to pass through a filter (i.e.,

Brent Stephens, Ph.D., is associate professor in the Department of Civil, Architectural, and Environmental Engineering at Illinois Institute of Technology in Chicago. He directs the Built Environment Research Group (BERG) (www.built-envi.com) and is the Research Subcommittee Chair for ASHRAE TC 2.4, Particulate Air Contaminants and Particulate Contaminant Removal Equipment. Terry Brennan is a building scientist and educator with Camroden Associates, Inc., in Westmoreland, N.Y. He is a member of ASHRAE SSSC 62.2. Lew Harriman is director of research at Mason-Grant Consulting in Portsmouth, N.H.

it can pass through the building enclosure in an exhaust-only configuration). This new requirement for homes begs the question: without ventilation air cleaning, is the quality of the replacement air any better than the air that is being exhausted? Quite commonly across the world, the answer is “no.”


To assist designers in improving IAQ in both residential and commercial buildings, we provide filter Minimum Efficiency Reporting Value (MERV) rating recommendations for 100 of the world’s most populous cities to achieve minimum outdoor air quality standards in the incoming ventilation air. These recommendations are based on local outdoor concentrations of $PM_{2.5}$.

Global Annual Average $PM_{2.5}$ Concentrations

Figure 1 shows estimates of the global spatial distribution of annual average ambient $PM_{2.5}$ concentrations in the most recent year for which data were available (2014), made using a combination of satellite-, simulation-, and monitor-based data sources.¹¹ These data are provided online at either $0.1^\circ \times 0.1^\circ$ or $0.01^\circ \times 0.01^\circ$ grid spacing.¹² Annual average ambient $PM_{2.5}$ concentrations across the world in 2014 ranged from less than $5 \mu\text{g}/\text{m}^3$ or $10 \mu\text{g}/\text{m}^3$ in parts of North America, South America, and Australia, to over $100 \mu\text{g}/\text{m}^3$ in portions of eastern Asia, southern Asia, and parts of northern and western Africa. These wide ranges of concentrations have major implications for human health in each region of the world.

For example, the concentration–response functions derived from epidemiology studies are typically on the order of a ~10% increase in the relative risk of a given adverse health outcome (e.g., mortality, stroke, or heart disease) for a $10 \mu\text{g}/\text{m}^3$ increase in long-term ambient $PM_{2.5}$ concentrations.¹³ This relationship is highly non-linear in some ambient $PM_{2.5}$ concentration ranges,⁵ although the evidence is clear that mitigating exposure to ambient-origin $PM_{2.5}$ can yield substantial improvements in global health. These $PM_{2.5}$ data are limited to annual averages in the year 2014

FIGURE 1 Global estimates of annual average ambient $PM_{2.5}$ concentrations in the year 2014 made using a combination of satellite-, simulation-, and monitor-based data sources.¹¹ The figure was created using Panoply: <http://www.giss.nasa.gov/tools/panoply/download.html>.

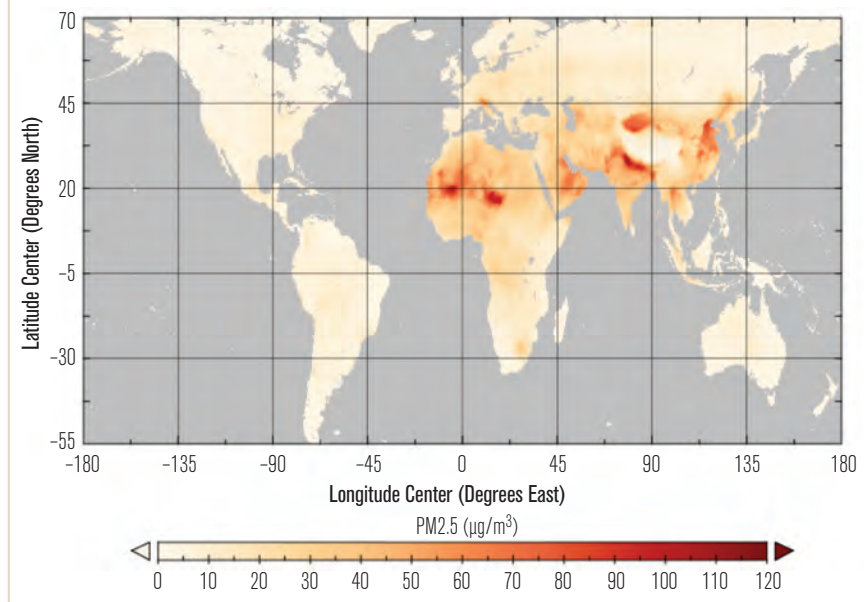

and will vary from day to day and year to year. Further, annual average outdoor $PM_{2.5}$ concentrations have been decreasing in some countries¹⁴ and increasing in others¹⁵ in recent years.

Minimum Filtration Requirements in ASHRAE Standards

Many HVAC filters available in the U.S. are rated for their particle removal efficiency using a laboratory test procedure described in ASHRAE Standard 52.2-2012, *Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size*.¹⁶ The test procedure classifies the single-pass particle removal efficiency of HVAC filters based on their minimum particle removal efficiency in three particle size bins ($0.3 \mu\text{m}$ to $1 \mu\text{m}$, $1 \mu\text{m}$ to $3 \mu\text{m}$, and $3 \mu\text{m}$ to $10 \mu\text{m}$) under various loading conditions. Minimum removal efficiency values in these three size bins are used to assign HVAC filters a single efficiency metric called the Minimum Efficiency Reporting Value (MERV).

In general, the higher the MERV, the greater the removal efficiency for one or more particle size bins. A similar test procedure and rating system is used in other parts of the world as well, including EN 779 from the European Committee for Standardization.¹⁷

ASHRAE Standard 62.1-2016 (for commercial buildings) currently requires a minimum of MERV 8 on the

mixed airstream,¹⁸ which was strengthened from MERV 6 in the 2010 version.¹⁹ ASHRAE Standard 62.2-2013 (for low-rise residential buildings) currently requires a minimum of MERV 6 on the recirculating airstream.²⁰ In residential buildings in particular, installing high-efficiency particle filtration on the outdoor air supply of a mechanical ventilation system has advantages over the alternatives of relying on infiltration air through the building enclosure or relying on unfiltered natural ventilation through open windows.

In areas where ambient air quality standards or guidelines for outdoor PM_{2.5} concentrations are regularly exceeded, both standards recommend using higher levels of particle filtration (e.g., MERV 11). However, the standards do not explicitly address the need for even higher levels of filtration in highly polluted environments such as many of the locations shown in *Figure 1*.


Approximating PM_{2.5} Removal Efficiency for MERV-Rated Filters

ASHRAE Standard 52.2-2012 does not explicitly test filters for their ability to remove PM_{2.5}. However, one can use results from ASHRAE Standard 52.2-2012 testing to approximate the removal efficiency for PM_{2.5} for a specific filter. The International Standards Organization (ISO) has recently published a new filter test standard that does consider the mass of particles captured by filters (ISO-16890),²¹ but here we use a different procedure to approximate the PM_{2.5} removal efficiency for MERV-rated filters. (For a discussion of ISO-16890, readers should refer to the Tronville and Rivers article, “Air Filter Performance: New Method for Testing,” in the May 2016 issue of *ASHRAE Journal*).

The particle removal efficiency of filters is strongly dependent on particle size. Both larger particles (i.e., greater than ~1 μm) and smaller particles (i.e., less than ~0.1 μm) are removed by typical fibrous media filters with greater efficiency than particle sizes in between ~0.1 μm and ~1 μm.²² ASHRAE Standard 52.2-2012 evaluates the removal efficiency of a filter on a particle number-basis, albeit only for particle sizes 0.3 μm to 10 μm.

However, the vast majority of particles (by number) in most outdoor environments are smaller than 0.3 μm, and much of the PM_{2.5} mass is often in the 0.5 μm to 1 μm size range.²³ Thus, the PM_{2.5} mass removal efficiency of a filter will vary depending on the filter’s

FIGURE 2 Estimates of particle removal efficiency for PM_{2.5} of outdoor origin for filters tested according to ASHRAE Standard 52.2-2012.²³

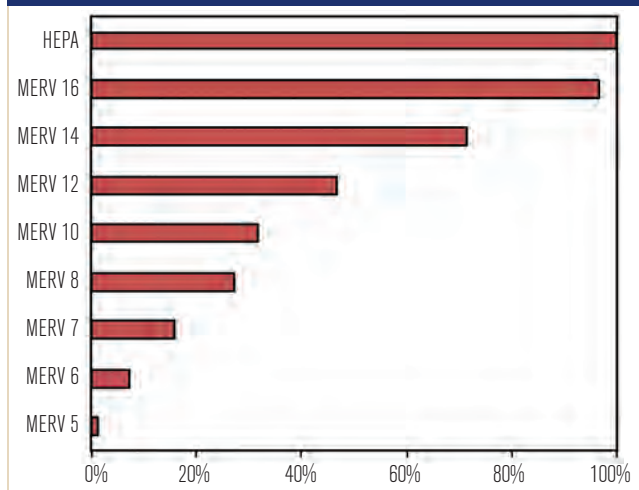

size-resolved removal efficiency for these particle sizes and the particle size distribution that passes through it.

Further, while filter removal test efficiencies from Standard 52.2-2012 testing are considered to be generally representative of real-life behavior, in practice results can vary widely based on particle size distributions, dust-loading conditions, face velocities, and bypass airflow conditions encountered in real buildings.

A recent study mapped nearly 200 outdoor particle size distributions found in the literature from around the world to size-resolved particle removal efficiencies of a wide range of MERV-rated HVAC filters measured in a laboratory setting,²⁴ and used these data to estimate their removal efficiencies for PM_{2.5} of outdoor origin.²³

Average values for approximated outdoor-origin PM_{2.5} removal efficiencies for several MERV-rated filters are shown in *Figure 2*. Single-pass outdoor-origin PM_{2.5} removal efficiencies range from less than 10% for MERV 6 to over 95% for MERV 16 and HEPA filters. The study showed that the representative PM_{2.5} removal efficiency for MERV 8 filters (i.e., the level of filtration currently required in Standard 62.1-2016) was less than 30%.

Selecting MERV-Rated Filters for Ventilation Air Based on PM_{2.5} Removal Efficiency

Next, consider the global estimates of annual average ambient PM_{2.5} concentrations in *Figure 1* and estimates of outdoor-origin PM_{2.5} removal efficiencies for the representative filters in *Figure 2*. The values can be used to form the basis of recommendations for

Advertisement formerly in this space.


minimum filtration levels needed for ventilation air in locations across the world. We located the coordinates of 100 of the world's largest metropolitan areas by population size²⁵ within the 0.1° × 0.1° global PM_{2.5} grid to assign an annual average PM_{2.5} concentration (in the year 2014) to each of the locations (only 99 locations were matched; one location lacked PM_{2.5} data). Each of these metropolitan areas has a population of at least 3 million people.

We then calculated the single-pass PM_{2.5} filter removal efficiency that would be needed on the outdoor air supply to bring the entering concentrations down to the U.S. EPA's current maximum annual average ambient PM_{2.5} concentration allowable under the National Ambient Air Quality Standards (NAAQS): 12 µg/m³.²⁶ This procedure conservatively assumes 100% outdoor air is being delivered; in the case of mixing with recirculated air, one would need to also consider the strength and size distributions of indoor PM_{2.5} sources.

Further, the World Health Organization (WHO) maintains a lower guideline value of 10 µg/m³ for annual average outdoor PM_{2.5} concentrations.²⁷ We primarily use the NAAQS value for consistency with applications in the U.S., but also explore the sensitivity to meeting the WHO guideline value. There is some evidence that both acute and chronic effects of ambient PM_{2.5} exposure persist below the current U.S. EPA standards.²⁸

Figure 3 shows the minimum filtration levels (i.e., MERV ratings) needed on outdoor air intakes to meet the NAAQS value in a subset of the 99 most populous locations worldwide that we analyzed, along with the 2014 annual average ambient PM_{2.5} concentrations in those locations. The full list of 99 cities is provided in Table 1. Of

FIGURE 3 Ventilation air filtration levels (MERV) needed to reduce entering outdoor PM_{2.5} concentrations to U.S. NAAQS maximum level of 12 µg/m³.

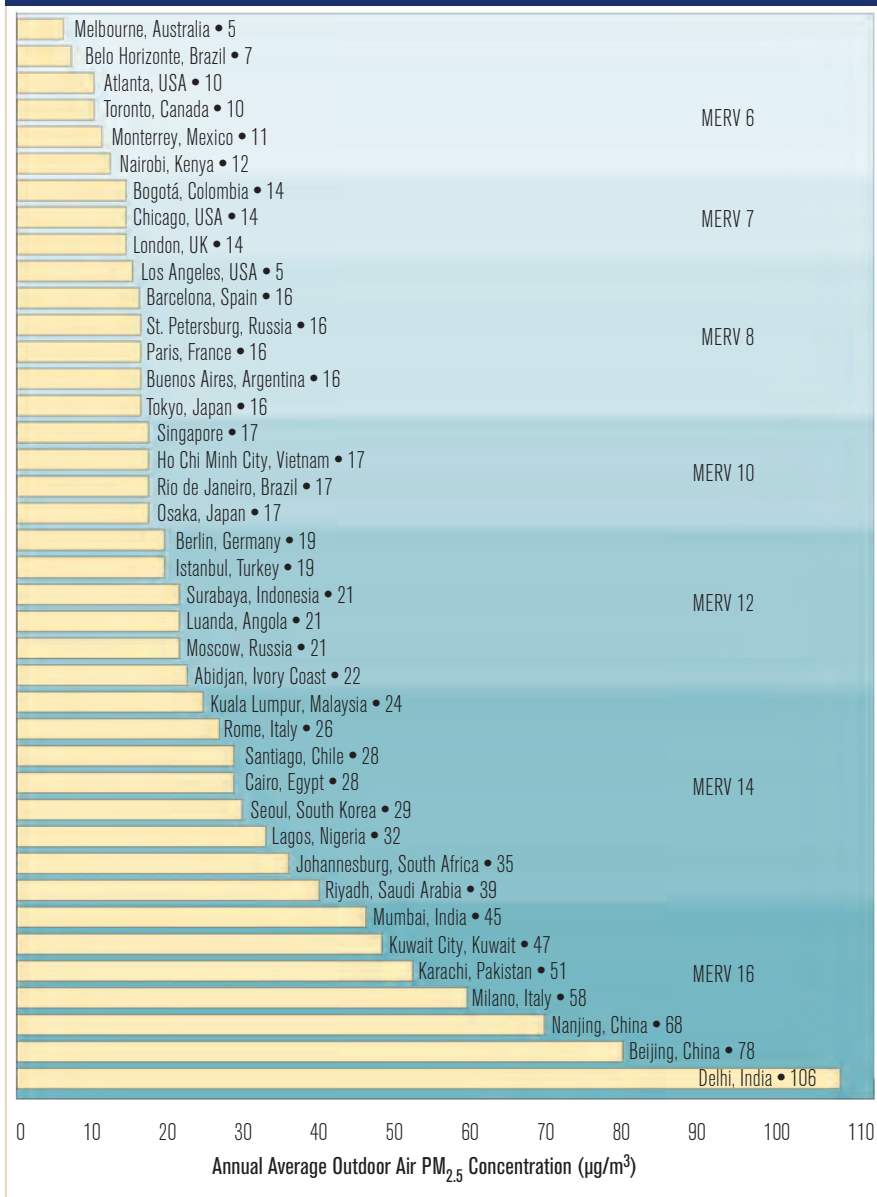

the 20 locations in the world with the highest ambient PM_{2.5} concentrations, 16 are located in China.

Filters with a minimum of MERV 16 would need to be installed on outdoor air intakes in those locations to bring PM_{2.5} concentrations in outdoor ventilation air down to EPA-recommended maximums. In over 30 other locations from Kuala Lumpur, Malaysia, to Surat, India, the minimum filtration level would need to be MERV 14 to meet U.S. EPA ambient air quality standards.

MERV 6 filters would need to be installed on the outdoor ventilation air in the 19 locations that have annual average ambient PM_{2.5} concentrations below 12 µg/m³,

TABLE 1 Ventilation air filtration levels needed to reduce entering outdoor PM_{2.5} concentrations to U.S. NAAQS maximum level of 12 µg/m³.

LOCATION	POPULATION	ANNUAL AVERAGE PM _{2.5} CONCENTRATION µg/m ³	PM _{2.5} REMOVAL EFFICIENCY NEEDED TO MEET NAAQS	MERV LEVEL NEEDED TO MEET NAAQS	LOCATION	POPULATION	ANNUAL AVERAGE PM _{2.5} CONCENTRATION µg/m ³	PM _{2.5} REMOVAL EFFICIENCY NEEDED TO MEET NAAQS	MERV LEVEL NEEDED TO MEET NAAQS
Delhi, India	24,134,000	106	89%	16	Dhaka, Bangladesh	14,816,000	25	52%	14
Zhengzhou, China	4,247,000	79	85%	16	Mexico City, Mexico	20,300,000	24	50%	14
Beijing, China	19,277,000	78	85%	16	Kuala Lumpur, Malaysia	6,635,000	24	50%	14
Tianjin, China	9,596,000	77	84%	16	Abidjan, Ivory Coast	4,765,000	22	45%	12
Wuhan, China	7,590,000	69	83%	16	Moscow, Russia	15,885,000	21	43%	12
Nanjing, China	5,854,000	68	82%	16	Luanda, Angola	5,654,000	21	43%	12
Xi'an, China	5,438,000	64	81%	16	Surabaya, Indonesia	5,057,000	21	43%	12
Hangzhou, China	6,776,000	63	81%	16	Bandung, Indonesia	5,764,000	20	40%	12
Chengdu, China	8,891,000	62	81%	16	Istanbul, Turkey	13,187,000	19	37%	12
Suzhou, China	4,545,000	62	81%	16	Berlin, Germany	4,006,000	19	37%	12
Lahore, Pakistan	8,376,000	61	80%	16	Osaka, Japan	17,234,000	17	29%	10
Shenyang, China	5,816,000	58	79%	16	Rio de Janeiro, Brazil	11,723,000	17	29%	10
Milan, Italy	5,264,000	58	79%	16	Ho Chi Minh City, Vietnam	9,031,000	17	29%	10
Harbin, China	4,609,000	56	79%	16	Singapore, Singapore	5,428,000	17	29%	10
Guangzhou, China	18,316,000	55	78%	16	Tokyo, Japan	37,555,000	16	25%	8
Chongqing, China	6,782,000	55	78%	16	Buenos Aires, Argentina	13,913,000	16	25%	8
Shanghai, China	22,650,000	53	77%	16	Paris, France	10,975,000	16	25%	8
Karachi, Pakistan	21,585,000	51	76%	16	Nagoya, Japan	10,238,000	16	25%	8
Qingdao, China	5,413,000	51	76%	16	Essen-Dusseldorf, Germany	6,722,000	16	25%	8
Dongguan, China	8,762,000	49	76%	16	St. Petersburg, Russia	5,132,000	16	25%	8
Kolkata, India	14,896,000	47	74%	16	Barcelona, Spain	4,656,000	16	25%	8
Pune, India	5,376,000	47	74%	16	Sao Paulo, Brazil	20,273,000	15	20%	8
Kuwait, Kuwait	3,929,000	47	74%	16	Los Angeles, United States	15,250,000	15	20%	8
Dalian, China	3,891,000	46	74%	16	London, United Kingdom	10,149,000	14	14%	7
Mumbai, India	17,672,000	45	73%	16	Chicago, United States	9,238,000	14	14%	7
Ahmedabad, India	6,930,000	45	73%	16	Bogota, Colombia	8,188,000	14	14%	7
Surat, India	4,897,000	42	71%	16	Madrid, Spain	6,183,000	12	< 10%	6
Tehran, Iran	13,429,000	41	71%	14	Nairobi, Kenya	4,652,000	12	< 10%	6
Quanzhou, China	6,030,000	40	70%	14	Phoenix, United States	4,174,000	12	< 10%	6
Riyadh, Saudi Arabia	5,231,000	39	69%	14	Dar es Salaam, Tanzania	3,915,000	12	< 10%	6
Bangkok, Thailand	14,910,000	37	68%	14	San Francisco, United States	5,996,000	11	< 10%	6
Kinshasa, Congo	9,735,000	37	68%	14	Philadelphia, United States	5,530,000	11	< 10%	6
Shenzhen, China	12,860,000	35	66%	14	Washington, D.C., United States	4,792,000	11	< 10%	6
Johannesburg, SA	7,960,000	35	66%	14	Guadalajara, Mexico	4,413,000	11	< 10%	6
Chennai, India	9,435,000	34	65%	14	Monterrey, Mexico	3,897,000	11	< 10%	6
Hyderabad, India	8,445,000	34	65%	14	New York, United States	20,661,000	10	< 10%	6
Medan, Indonesia	3,992,000	34	65%	14	Toronto, Canada	6,345,000	10	< 10%	6
Baghdad, Iraq	6,534,000	33	64%	14	Houston, United States	5,567,000	10	< 10%	6
Khartoum, Sudan	5,069,000	33	64%	14	Atlanta, United States	4,849,000	10	< 10%	6
Lagos, Nigeria	12,549,000	32	63%	14	Dallas, United States	6,077,000	9	< 10%	6
Yangon, Myanmar	4,714,000	32	63%	14	Boston, United States	4,499,000	8	< 10%	6
Hong Kong, China	7,050,000	31	61%	14	Miami, United States	5,817,000	7	< 10%	6
Bangalore, India	9,330,000	30	60%	14	Belo Horizonte, Brazil	4,486,000	7	< 10%	6
Seoul, South Korea	22,992,000	29	59%	14	Sydney, Australia	3,980,000	6	< 10%	6
Ankara, Turkey	4,299,000	29	59%	14	Melbourne, Australia	3,788,000	5	< 10%	6
Cairo, Egypt	15,206,000	28	57%	14					
Lima, Peru	9,668,000	28	57%	14					
Taipei, Taiwan	7,317,000	28	57%	14					
Santiago, Chile	6,243,000	28	57%	14					
Accra, Ghana	4,219,000	28	57%	14					
Jakarta, Indonesia	29,959,000	27	56%	14					
Busan, South Korea	3,975,000	26	54%	14					
Rome, Italy	3,798,000	26	54%	14					
Manila, Philippines	22,710,000	25	52%	14					

albeit only to be consistent with minimum requirements in ASHRAE Standards 62.1-2016 and 62.2-2016 (MERV 6 filters will still protect equipment from fouling by larger dust and debris particles even in unpolluted areas). Note that the majority of these lower concentration cities are located in the United States, where the U.S. EPA standards apply.

Last, when designers wish to achieve this same level of particulate air cleaning in international locations not shown in *Figure 3*, *Table 2* lists recommended MERV levels to meet both the U.S. NAAQS value (12 µg/m³) and the WHO guideline value (10 µg/m³) based on ranges of annual average ambient PM_{2.5} concentrations alone. Even higher levels of HVAC filtration would be required to meet the WHO guideline values.

Summary

Although ASHRAE Standards 62.1 and 62.2 maintain minimum particle filtration requirements for air passing through thermal conditioning components, the requirements do not explicitly consider filtration of the pollutant that is known to be the largest contributor to adverse human health effects: PM_{2.5} in outdoor air entering the building.

While the requirements in Standard 62.1-2016 and Standard 62.2-2016 are considered generally sufficient to achieve PM_{2.5} levels that meet outdoor air quality standards for most U.S. locations, they are inadequate for most of the global cities addressed in this article. HVAC designers and owners, especially of buildings located in portions of eastern Asia, southern Asia, and parts of northern and western Africa, must make their own decisions without guidance from either regulatory authorities or from ASHRAE’s consensus standards. When designers wish to make incoming ventilation air at least as clean as minimum EPA standards or WHO guidelines for outdoor air, the filtration recommendations provided in this article may be helpful.

Due to growing evidence of health effects of outdoor air pollutants at levels below EPA standards and WHO guidelines, some may also choose to provide enhanced particle filtration to achieve even lower PM_{2.5} concentrations indoors. Since we spend nearly 90% of our lives indoors, some may decide that indoor air quality should not be worse than what we know to be unhealthy in outdoor air.

TABLE 2 Ventilation filter MERV levels needed to meet EPA NAAQS and WHO guidelines equivalence-based annual average ambient PM_{2.5} concentrations.

Recommended MERV Level	Annual Average Ambient PM _{2.5} Concentration Range (µg/m ³) Required to Meet:	
	NAAQS Value: 12 µg/m ³	WHO Guideline: 10 µg/m ³
MERV 6	<12	0 to 10
MERV 7	12 to 14	10 to 11
MERV 8	15 to 16	12 to 13
MERV 10	17 to 18	14
MERV 12	19 to 23	15 to 18
MERV 14	24 to 42	19 to 34
MERV 16	43 to 324	35 to 270
HEPA	325+	271+

Acknowledgments

This work was supported in part by the U.S. Environmental Protection Agency, Office of Radiation and Indoor Air, Indoor Environments Division. The views expressed in this document are solely those of the authors and do not necessarily reflect those of the Agency. EPA does not endorse any products or commercial services mentioned in this publication. Brent Stephens was also supported in part by an ASHRAE New Investigator Award.

References

1. West, J., et al. 2016. “What we breathe impacts our health: improving understanding of the link between air pollution and health.” *Environmental Science and Technology* 50(10):4895–4904.
2. EPA. 2009. “2009 Final Report Integrated Science Assessment for Particulate Matter.” EPA/600/R-08/139F. U.S. Environmental Protection Agency: National Center for Environmental Assessment.
3. Forouzanfar, M.H., et al. 2015. “Global, regional, and national comparative risk assessment of 79 behavioural, environmental and occupational, and metabolic risks or clusters of risks in 188 countries, 1990–2013: a systematic analysis for the Global Burden of Disease Study 2013.” *The Lancet* 386(10010):2287–2323.
4. Lelieveld, J., J.S. Evans, M. Fnais, D. Giannadaki, A. Pozzer. 2015. “The contribution of outdoor air pollution sources to premature mortality on a global scale.” *Nature* 525(7569):367–371.
5. Burnett, R.T., et al. 2014. “An integrated risk function for estimating the global burden of disease attributable to ambient fine particulate matter exposure.” *Environmental Health Perspectives* 122(4):397–403.
6. Ji, W., B. Zhao 2015. “Estimating mortality derived from indoor exposure to particles of outdoor origin.” *PLOS ONE* 10(4):e0124238.
7. Montgomery, J.F., C.C. Reynolds, S.N. Rogak, S.I. Green. 2015. “Financial implications of modifications to building filtration systems.” *Building and Environment* 85:17–28.

Advertisement formerly in this space.

Advertisement formerly in this space.

8. Chan, W.R., S. Parthasarathy, W.J. Fisk, T.E. McKone. 2016. "Estimated effect of ventilation and filtration on chronic health risks in U.S. offices, schools, and retail stores." *Indoor Air* 26(2):331–343.
9. Bekö, G., G. Clausen, C. Weschler. 2008. "Is the use of particle air filtration justified? Costs and benefits of filtration with regard to health effects, building cleaning and occupant productivity." *Building and Environment* 43(10):1647–1657.
10. Stephens, B. 2015. "Building design and operational choices that impact indoor exposures to outdoor particulate matter inside residences." *Science and Technology for the Built Environment* 21(1):3–13.
11. van Donkelaar, A., et al. 2016. "Global estimates of fine particulate matter using a combined geophysical-statistical method with information from satellites, models, and monitors." *Environmental Science and Technology* 50(7):3762–3772.
12. Dalhousie University. 2014. "Surface PM_{2.5}" Atmospheric Composition Analysis Group. <http://tinyurl.com/jhwdc6g>.
13. Zhao, D., P. Azimi, B. Stephens. 2015. "Evaluating the long-term health and economic impacts of central residential air filtration for reducing premature mortality associated with indoor fine particulate matter (PM_{2.5}) of outdoor origin." *International Journal of Environmental Research and Public Health* 12(7):8448–8479.
14. EPA. 2016. "National Air Quality: Status and Trends of Key Air Pollutants." U.S. Environmental Protection Agency. <https://www.epa.gov/air-trends>.
15. WHO. 2016. "Air Pollution Levels Rising in Many of the World's Poorest Cities." World Health Organization. <http://tinyurl.com/zzbn05w>.
16. ASHRAE Standard 52.2-2012, *Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size*.
17. CEN EN 779-2012, *Particulate Air Filters for General Ventilation—Determination of the Filtration Performance*.
18. ASHRAE Standard 62.1-2016, *Ventilation for Acceptable Indoor Air Quality*.
19. ASHRAE Standard 62.1-2010, *Ventilation for Acceptable Indoor Air Quality*.
20. ASHRAE Standard 62.2-2016, *Ventilation and Acceptable Indoor Air Quality in Low-Rise Residential Buildings*.
21. ISO/FDIS 16890-1-2016, *Air Filters for General Ventilation—Part 1: Technical Specifications, Requirements and Classification System Based Upon Particulate Matter Efficiency (ePM)*.
22. Hinds, W.C. 1999. *Aerosol Technology: Properties, Behavior, and Measurement of Airborne Particles*, Chap. 9. Wiley.
23. Azimi, P., D. Zhao, B. Stephens. 2014. "Estimates of HVAC filtration efficiency for fine and ultrafine particles of outdoor origin." *Atmospheric Environment* 98:337–346.
24. Hecker, R., K.C. Hofacre. 2008. Development of Performance Data for Common Building Air Cleaning Devices: Final Report. EPA/600/R-08/013; U.S. Environmental Protection Agency: Office of Research and Development/National Homeland Security Research Center.
25. Demographia. 2016. "Demographia World Urban Areas, 12th Annual Edition." <http://tinyurl.com/3ohwzu>.
26. EPA. 2016. "NAAQS Table." U.S. Environmental Protection Agency. <http://tinyurl.com/jfyordg>.
27. WHO. 2006. "WHO Air Quality Guidelines for Particulate Matter, Ozone, Nitrogen Dioxide and Sulfur Dioxide." World Health Organization. <http://tinyurl.com/pbqv8wx>.
28. Shi, L., et al. 2015. "Low-concentration PM_{2.5} and mortality: estimating acute and chronic effects in a population-based study." *Environmental Health Perspectives* 124(1):46–52. ■